

LINCOLNSHIRE COUNTY COUNCIL'S RESPONSE TO CONSULTATION ON THE FOLLOWING DEVELOPMENT PROPOSAL

District: South Kesteven District Council

Application number: S24/1040

Application Type: Full – Major Planning Application

Proposal: Installation of solar farm with associated battery storage, comprising ground mounted solar photovoltaic panels, including mounting systems, inverters and transformers, electrical substation, underground cabling, stock proof fencing, CCTV, internal access tracks and associated infrastructure for a temporary period of 40 years

Location: Pastures Farm , High Dike, Welby, Lincolnshire, NG32 3LU

Response Date: 19 July 2024

This report includes the Substantive response of the Local Highway and Lead Local Flood Authority to a planning consultation received under the Development Management Order and includes details of any planning conditions or informatives that should be attached in the event that permission is granted and any obligations to be secured by way of a S106 agreement.

General Information and Advice

Please note that although the Definitive Map and Statement proves the existence of any recorded rights of way, there may be further or higher rights that are not shown on this document that the County Council is not currently aware of. This would be especially relevant where the public has had informal access to the site or where there are references to routes across this in maps or other historic documents. As the County Council has received no application to recognise further rights of way affecting the site, no more informed guidance can be offered at this stage.

Application number: S24/1040

Application Type: Full – Major Planning Application

Location: Pastures Farm , High Dike, Welby, Lincolnshire, NG32 3LU

Highway and Lead Local Flood Authority Report

Substantive Response provided in accordance with article 22(5) of The Town and Country Planning (Development Management Procedure) (England) Order 2015:

Recommendation: No Objection

Comments:

The proposal is for the Installation of solar farm with associated battery storage, comprising ground mounted solar photovoltaic panels, including mounting systems, inverters and transformers, electrical substation, underground cabling, stock proof fencing, CCTV, internal access tracks and associated infrastructure for a temporary period of 40 years. The site is located between Ancaster and Grantham to the East of the B6403.

It is proposed that the site will be accessed off the B6403. The B604 is capable of taking the vehicle movements and the applicant has demonstrated that the access is suitable.

As Lead Local Flood Authority, Lincolnshire County Council is required to provide a statutory planning consultation response with regard to Drainage on all Major Applications. This application is proposing that the site continue to drain as it does naturally, due to the fact there is little increase in impermeable areas on the site. Therefore, the Lead Local Flood Authority does not consider that this proposal would increase flood risk in the immediate vicinity of the site.

No Objections

Having given due regard to the appropriate local and national planning policy guidance (in particular the National Planning Policy Framework), Lincolnshire County Council (as Highway Authority and Lead Local Flood Authority) has concluded that the proposed development would not be expected to have an unacceptable impact upon highway safety or a severe residual cumulative impact upon the local highway network or increase surface water flood risk and therefore does not wish to object to this planning application.

Informatives

Highway Informative 02


In accordance with Section 59 of the Highways Act 1980, please be considerate of causing damage to the existing highway during construction and implement mitigation measures as necessary. Should extraordinary expenses be incurred by the Highway Authority in maintaining the highway by reason of damage caused by construction traffic, the Highway Authority may seek to recover these expenses from the developer.

Highway Informative 08

Please contact the Lincolnshire County Council Streetworks and Permitting Team on 01522 782070 to discuss any proposed statutory utility connections, Section 50 licences and any other works which will be required within the public highway in association with the development permitted under this Consent. This will enable Lincolnshire County Council to assist in the coordination and timings of these works. For further guidance please visit the Highway Authority's website via the following link: Traffic Management - <https://www.lincolnshire.gov.uk/traffic-management>

Public Rights of Way & Access Comments

The red line boundary extends in a southerly direction along High Dike. It would therefore be desirable to provide a behind the hedge public footpath or permissive footpath connecting Wilsford BW 13, Welby PF 4 and Welby PF 3 as indicated by the solid red line below.

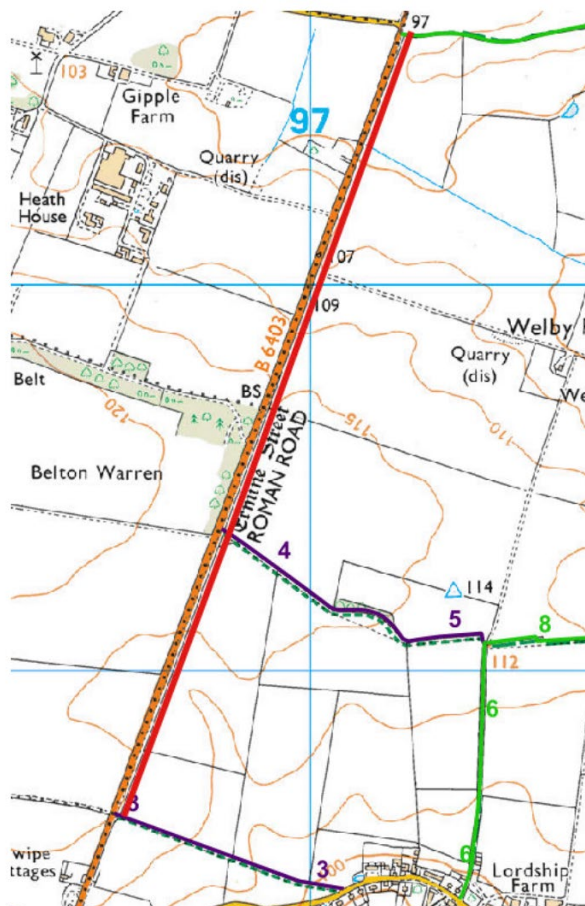

Andy Savage
Senior Countryside Officer

Officer's Name: Joseph Walden
Officer's Title: Senior Development Management Officer
Date: 19 July 2024

Ref: S24/1040
Pastures Farm, High Dike, Welby, Lincolnshire NG32 3LU

17.07.2024

Dear Sir or Madam

TOWN AND COUNTRY PLANNING ACT 1990
PLANNING CONSULTATION – NOTES FROM THE FIRE AND RESCUE AUTHORITY

In order to be successful in firefighting, adequate access to buildings for fire appliances and immediate access to adequate supplies of water, must be provided. The access to, and proximity of, those water supplies directly affects the resources that Fire and Rescue Authorities need to provide in protecting and mitigating their communities from the effects of fire.

Please find below a list of Lincolnshire Fire and Rescue Authority requirements relating to access for fire appliances and firefighting water supplies.

ACCESS

1. Access to buildings for fire appliances and fire fighters must meet with the requirements specified in Building Regulations 2010 Part B5. For small buildings (up to 2000m², with a top occupied storey that is a maximum of 11m above ground level), vehicle access for a pump appliance should be provided to whichever is the less onerous of the following:
 - a. 15% of the perimeter.
 - b. Within 45m of every point of the footprint of the building

For all other buildings, provide vehicle access in accordance with Table 15.1 of Approved Document. These requirements may be satisfied with other equivalent standards relating to access for firefighting.

Lincolnshire Fire and Rescue requires a minimum carrying capacity for hard standing for pumping appliances of 18 tonnes, not 12.5 tonnes as detailed in the Building Regulations 2000 part B5.

2. If it is not possible to provide access to the proposed development in accordance with the guidance details within Part B5 of Approved Document B, as compensation, Lincolnshire Fire and Rescue may accept the provision, at the developer's expense, of an automatic sprinkler system, designed, fitted and maintained in accordance with the relevant sections of BS5306/BSEN12845:2004.

Should this option be considered, our Fire Safety advisers must be provided with detailed plans of the proposed sprinkler installation. Any scheme proposed should not be of a lesser standard than any provision as may be required by the Building Regulations.

WATER SUPPLIES

3. A building requires additional fire hydrants if both of the following apply.
 - a. It has a compartment with an area more than 280m².
 - b. It is being erected more than 100m from an existing fire hydrant.

If additional hydrants are required, these should be provided in accordance with the following:

- a. For buildings provided with fire mains – within 90m of dry fire main inlets.
- b. For buildings not provided with fire mains – hydrants should be both of the following:
 - i. Within 90m of an entrance to the building.
 - ii. A maximum of 90m apart.

**All fire hydrants should conform to BS750-2012 Each fire hydrant should be clearly indicated by a plate, fixed nearby in a conspicuous position, in accordance with BS 3251.*

Guidance on aspects of provision and siting of private fire hydrants is given in BS 9990. Fire hydrant acceptance testing will be carried out by a Hydrant Inspector on completion and a standard hydrant marker "H" plate will be fitted nearby. Following adoption the Fire Service will be responsible for the ongoing maintenance and repairs for the lifetime of the fire hydrant.

4. Where at the time, it is not possible to determine the number of fire hydrants required for firefighting purposes, the requirement should be determined at the water planning stage when site plans have been submitted by the water companies.
5. Where no piped water supply is available, or there is insufficient pressure and flow in the water main, or an alternative arrangement is proposed, the alternative source of supply should be provided in accordance with the following recommendations
 - a. a charged static water tank of at least 45,000 litres capacity; or

- b. a spring, river, canal or pond capable of providing or storing at least 45,000 litres of water at all times of the year, to which access, space and a hard standing are available for a pumping appliance; or
- c. any other means of providing a water supply for firefighting operations considered appropriate by the fire and rescue authority.

ENVIRONMENTAL

- 6. Bulk storage of highly flammable/explosive/water reactive/toxic substances and any site whereas large scale recycling activities are proposed will need to be specifically consulted with Fire Authority to ensure that the full operational impact, should a fire occur, is assessed and that an adequate provision is recommended.
- 7. There are a number of methods available, through which the fire water runoff problem can be addressed, the most obvious being to use a fire suppression system to contain a fire, thus not requiring large volumes of water and containment measures, such as bund walls or drainage systems with lagoons, interceptors, reed beds or treatment plants. It is not for the fire service to stipulate which approach to take, simply to ensure that suitable measures are made a condition of planning approval through a firefighting water run-off strategy.

Battery Energy Storage System (BESS) Requirements

Lincolnshire Fire and Rescue (LFR) recognises the use of batteries (including lithium-ion) as Energy Storage Systems (ESS) is a new and emerging practice in the global renewable energy sector. As with all new and emerging practices within UK industry the Service would like to work with the developers to better understand any risks that may be posed and develop strategies and procedures to mitigate these risks.

We will work and engage with the developer as the project evolves, to ensure it complies with the statutory responsibilities that we enforce.

The developer should produce a risk reduction strategy (Regulation 38 of the Building Regulations) as the responsible person for the scheme as stated in the Regulatory Reform (Fire Safety) Order 2005. We would also expect that safety measures and risk mitigation is developed in collaboration with LFR.

The strategy should cover the construction, operational and decommissioning phases of the project.

During the construction phase the number of daily vehicle movements in the local area will significantly increase. The Service will want to view the transport strategy to minimise this impact and prevent an increase in the number of potential road traffic incidents. Any development should not negatively impact on the Service's ability to respond to an incident in the local area.

LFR works within the guidance of the National Fire Chief's Council (NFCC) who have been working with several government departments to ensure that fire and rescue services are made aware of any new proposals. NFCC have created a guidance document (link below) that constitutes LFR's requirements for new BESS development proposals.

[NFCC Grid Scale BESS planning – Guidance for FRS \(nfcc.org.uk\)](https://www.nfcc.org.uk)

Following the work of NFCC, the Department for Levelling Up, Housing and Communities (DLUHC) has revised its Planning Policy Guidance to include reference to BESS. The guidance is available here: [Renewable and low carbon energy - GOV.UK \(www.gov.uk\)](https://www.gov.uk)

LFR are aware that large scale BESS is a fairly new technology, and as such risks may or may not be captured in current guidance in pursuance of the Building Regulations (as amended) and the Regulatory Reform (Fire Safety) Order 2005. This will highlight challenges the FRS have when responding to Building Regulations consultations. For this reason, we strongly recommend applying the National Fire Protection Association (NFPA) 855 Standard for the Installation of Stationary Energy Storage Systems.

Failure to comply with the above requirements at planning stage can seriously compromise firefighting operations resulting in unnecessary risk to life, loss of property and unnecessary damage to the environment.

Should you wish to discuss adequacy of access or water supplies to your proposed development, please contact the Community Fire Protection department on 01522 553868.

Yours faithfully

Nick Morris

Station Manager Prevention & Protection
Lincolnshire Fire and Rescue
Lincolnshire County Council
Fire & Police Headquarters Deepdale Lane Nettleham